


# Desert Basin 230kV Tie

Tom Novy  
Transmission Planning

CATS-HV Meeting  
April 18, 2006



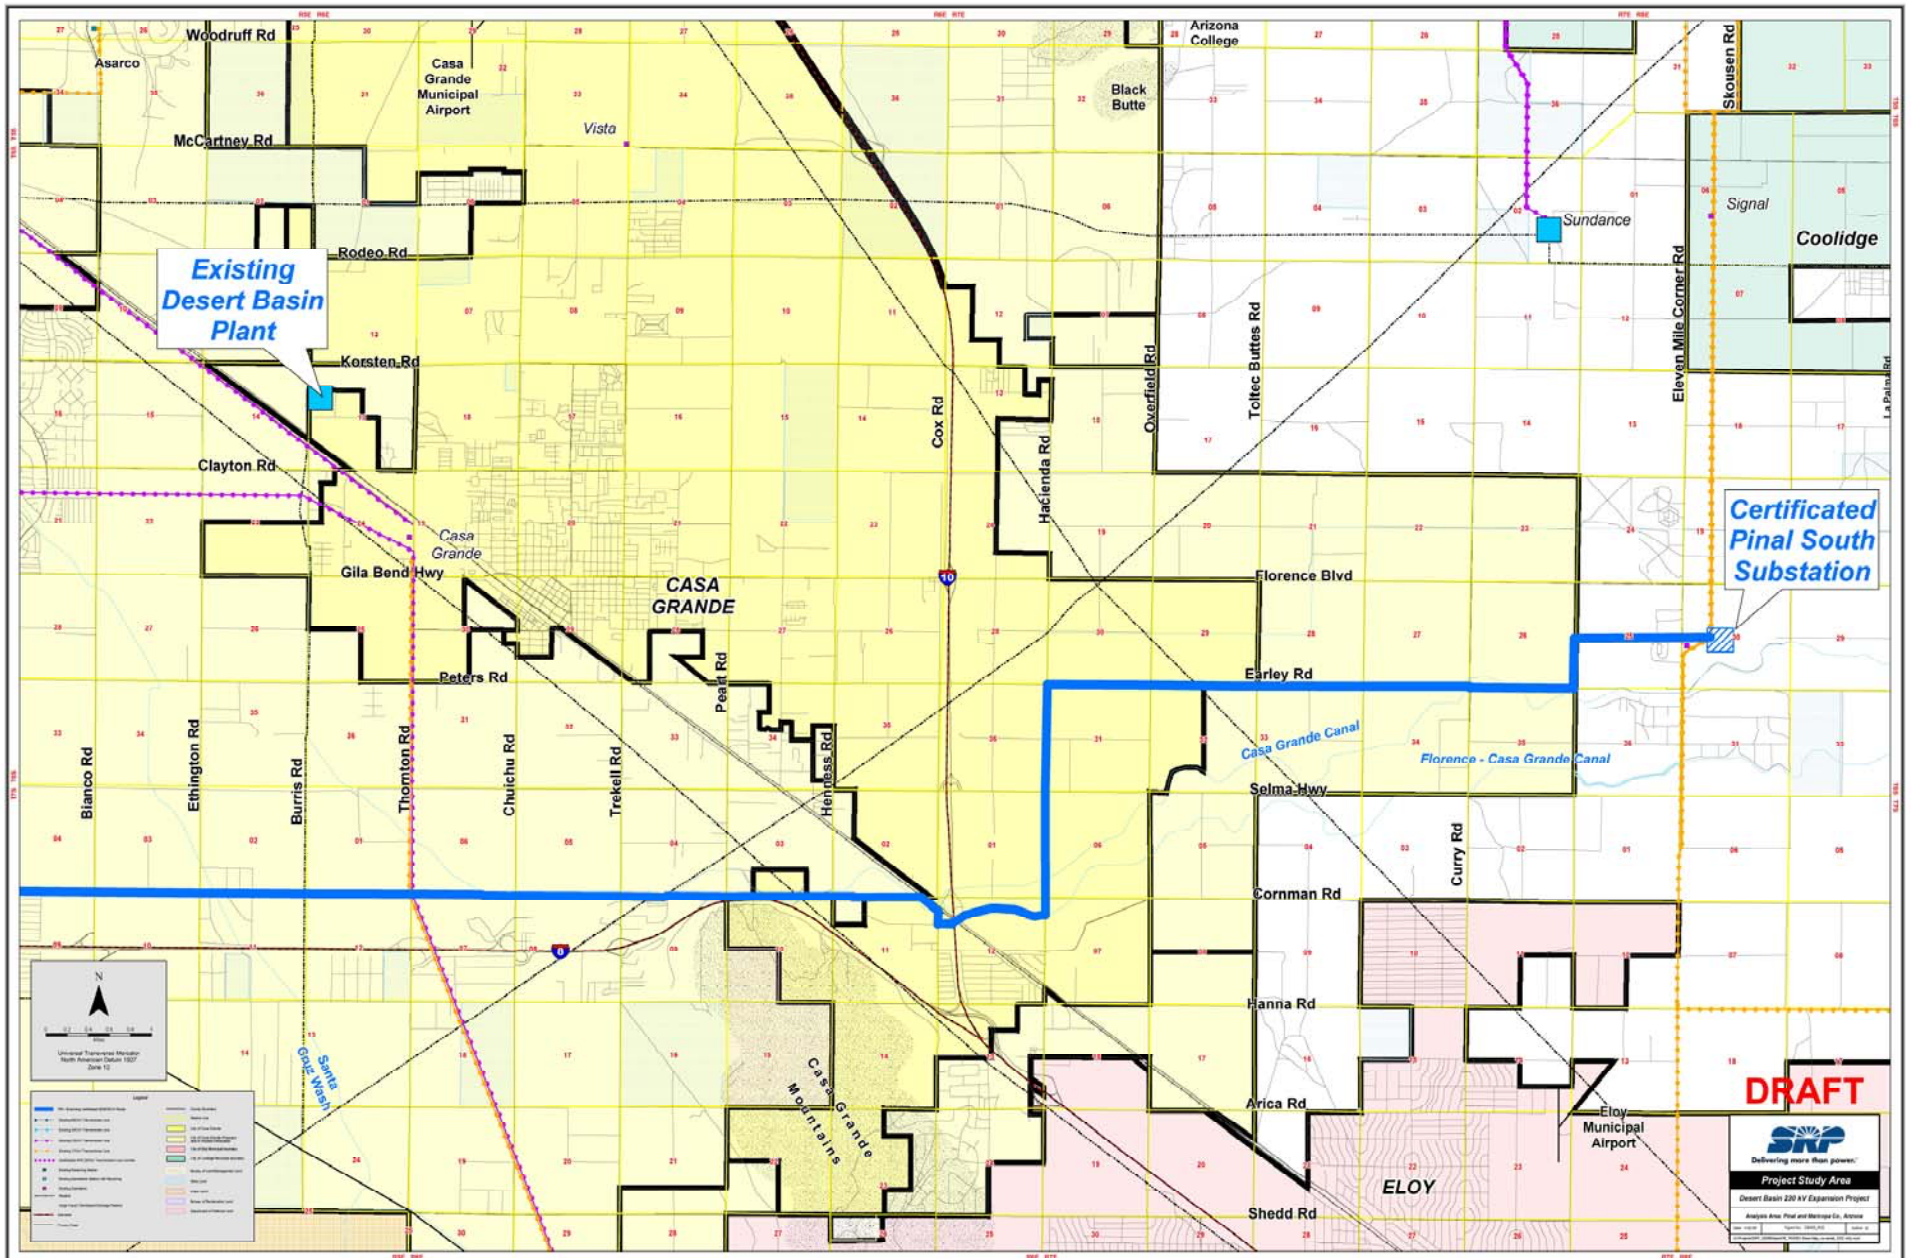

# DESERT BASIN 230kV TIE

## Potential Project Benefits:

- This line would increase plant reliability by allowing removal of the Remedial Action Scheme (RAS)
- It will increase regional transmission system reliability
- It will increase regional transmission system capacity
- This line will provide a more economical way for SRP to move energy from the Desert Basin Plant
- The line will increase local load serving capability
- First 230kV transmission component of the CATS-HV plan
- Provides transmission capability for potential additional generation at the desert Basin Plant
- Establishes a 230kV bus at Pinal South

# Other Thoughts/Comments

- We would like to move fairly quickly with this project, however, we're just presenting this to our Power committee this Thursday
- We didn't want to miss the opportunity of presenting it to you in this CATS-HV forum
- We will go through a typical "open season announcement" to solicit participation in the project
- We will, however, be talking with some of you on a one on one basis prior to the open invitation
- We encourage any of you to contact me, Rob or Chuck Russell